



REPUBLIC OF THE PHILIPPINES
COMMISSION ON AUDIT
REGIONAL OFFICE NO. XII
Brgy. Paraiso, Koronadal City

BIDS AND AWARDS COMMITTEE

NOTICE TO BIDDERS

Supplemental/Bid Bulletin No. 2023-001
Series of 2023

Project: **SUPPLY, DELIVERY AND INSTALLATION OF ONE (1)
GENERATOR SET WITH AUTOMATIC TRANSFER SWITCH
(Bid No. COA RO12-2023-001)**

Date: **May 2, 2023**

This Supplemental/Bid Bulletin No. 001 is hereby issued pursuant to Section 22.5.1 of the 2016 Revised Implementing Rules and Regulations of Republic Act No. 9184 in order to clarify and/or amend items in the Invitation to Bid and on the Bidding Documents and shall form an integral part thereof.

REFERENCE	CLARIFICATIONS/ AMENDMENTS
<i>Section VI. Schedule of Requirements (Column 2) (page 25)</i>	Additional Requirements: 1. The Automatic Transfer Switch (ATS) is separate from the main unit; 2. At least one (1) Service Center located in Mindanao to service the unit to be delivered, preferably in the area of Davao City or General Santos City; and 3. Provision of base pad for the generator set as per attached Annex "A" Floor Plan.

Any provision in the Invitation to Bid or on the Bidding Documents inconsistent herewith is hereby amended, modified, and superseded accordingly.


For guidance and information of all concerned.

Issued this 2nd day of May 2023 in the City of Koronadal, South Cotabato, Philippines.

ATTY. ABDUL GAFFAR R. ALI

Attorney VI/Acting Assistant Regional Director
BAC Chairperson

By The Authority of the Chairperson:

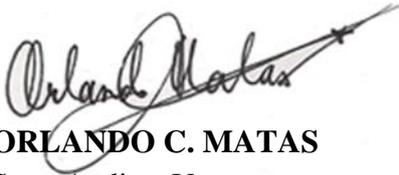A handwritten signature in black ink, appearing to read "Orlando C. Matas", with a long horizontal stroke extending to the right.

ORLANDO C. MATAS

State Auditor V

Vice-Chairperson, BAC

**SUPPLEMENTAL / BID BULLETIN No. 2023-001
Series of 2023**

**Project: SUPPLY, DELIVERY AND INSTALLATION OF ONE (1)
GENERATOR SET WITH AUTOMATIC TRANSFER SWITCH
(Bid No. COA RO12-2023-001)**

SPECIFICATIONS AND FLOOR PLAN

I. For Generator Manufacturer:


- a. If the Supplier is the Manufacturer, only the Certificate of Manufacturer must be submitted. If the Supplier is a Distributor, both Certificate of Manufacturer and Distributorship must be submitted.
 - i. Certificate of Distributorship (Red Ribbon)
 - ii. Certificate of Manufacturer
- b. Certificate of Factory Coupling from Manufacturer
- c. Certificate of Load Bank Testing from Manufacturer

II. For the Technical Specifications:

- a. The Automatic Transfer Switch (ATS) is separate from the Generator Set

III. Other Requirement/s:

- a. Warranty: 1 year for parts & services or 4,000 running hours whichever comes first
- b. Generator Pad Specifications (Floor Plan)

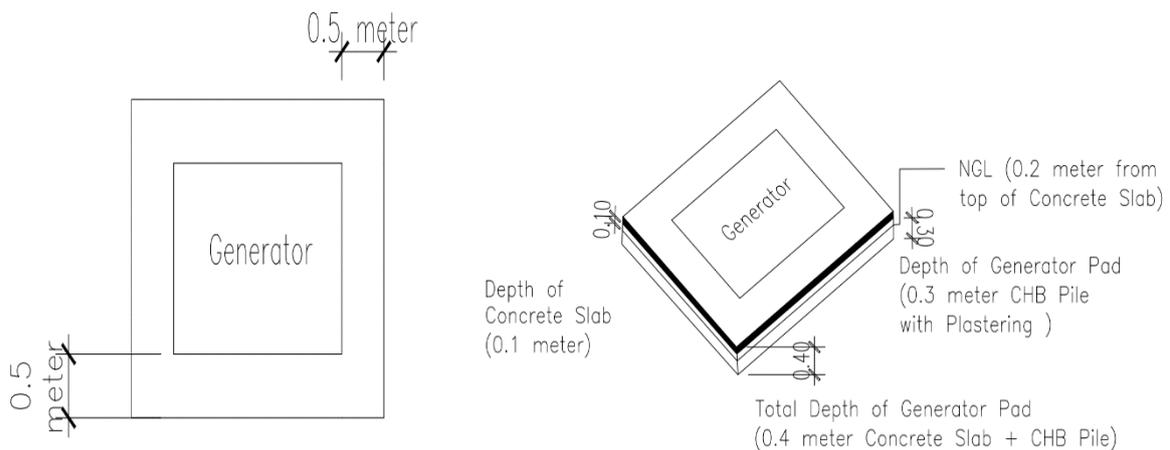

Note: There should be a 0.5 meter working space around the Generator set.